

PALECEK®

601 PARR BOULEVARD | RICHMOND | CA 94801

SCONCE INSTALLATION INSTRUCTIONS

Charlize Sconce

288679

PROFESSIONAL INSTALLATION REQUIRED

CAUTION: BEFORE INSTALLING FIXTURE, MAKE SURE THE POWER TO THE CIRCUIT IS TURNED OFF AT THE MAIN FUSE BOX / CIRCUIT BREAKER UTILITY BOX.

Important Safety Instructions:

- These instructions are provided for your safety. It is important that they are read carefully before use to ensure safe operation of the product.
- Installation by a licensed professional electrician required.
- THIS PRODUCT MUST BE INSTALLED IN ACCORDANCE WITH THE APPLICABLE INSTALLATION CODES BY A PERSON FAMILIAR WITH THE CONSTRUCTION AND OPERATION OF THE PRODUCT AND THE HAZARDS INVOLVED.
- The Installer must be familiar with commercial – type application of very heavy chandeliers / sconces.
- The Fixture is heavy so it is recommended to install it on junction box and as well as on wall with Anchors and Fasteners.
- The lighting fixture is meant for indoor use. It must be connected only to 3-wire, single-phase electrical supply systems (provided with Ground wire or equivalent protection system).
- For your safety, it is strongly recommended that two people install the lighting fixture.
- The lighting fixture is meant for indoor use, DRY LOCATIONS ONLY.
- Save these instructions.

WARNING:


- To reduce the risk of fire, electrical shock or personal injury, always turn off light fixture and allow it to cool prior to replacing LED.
- Do not touch fixture is turned on. Do not look directly at lit LED.
- Keep flammable materials away from lit LED.
- Check the cable properly for any loose or damaged connections.
- When the unit is no longer functioning, do not attempt to fix it by yourself. Only a qualified technician is allowed to disassemble and repair.
- If the external flexible cable cord of this luminaire is damaged it shall be exclusively replaced by a qualified electrician in order to avoid hazard.



Pre-Assembly:

- Remove all parts and hardware from the box along with any plastic protective packaging. Do not discard contents until after assembly is complete to avoid accidentally discarding small parts or hardware.
- **TOOLS REQUIRED (not included):** Ladder, Phillips Head Screw Driver, Wire Cutter/Stripper & Electrical Tape.
- **HARDWARE REQUIRED (not included):** Four Flush Anchors & four Fastener Bolts (based on your wall type).

Parts List:

- (A) Mounting plate
- (B) Inner Box
- (C) Holding Screws – 4 units
- (D) Sconce
- (E) Holding Brackets – 2 units
- (F) Alabaster Panel Large
- (G) Alabaster Panel Small
- (H) Holding Screws – 2 units
- (I) Allen Key
- (J) Junction Box Screw – 2 Units

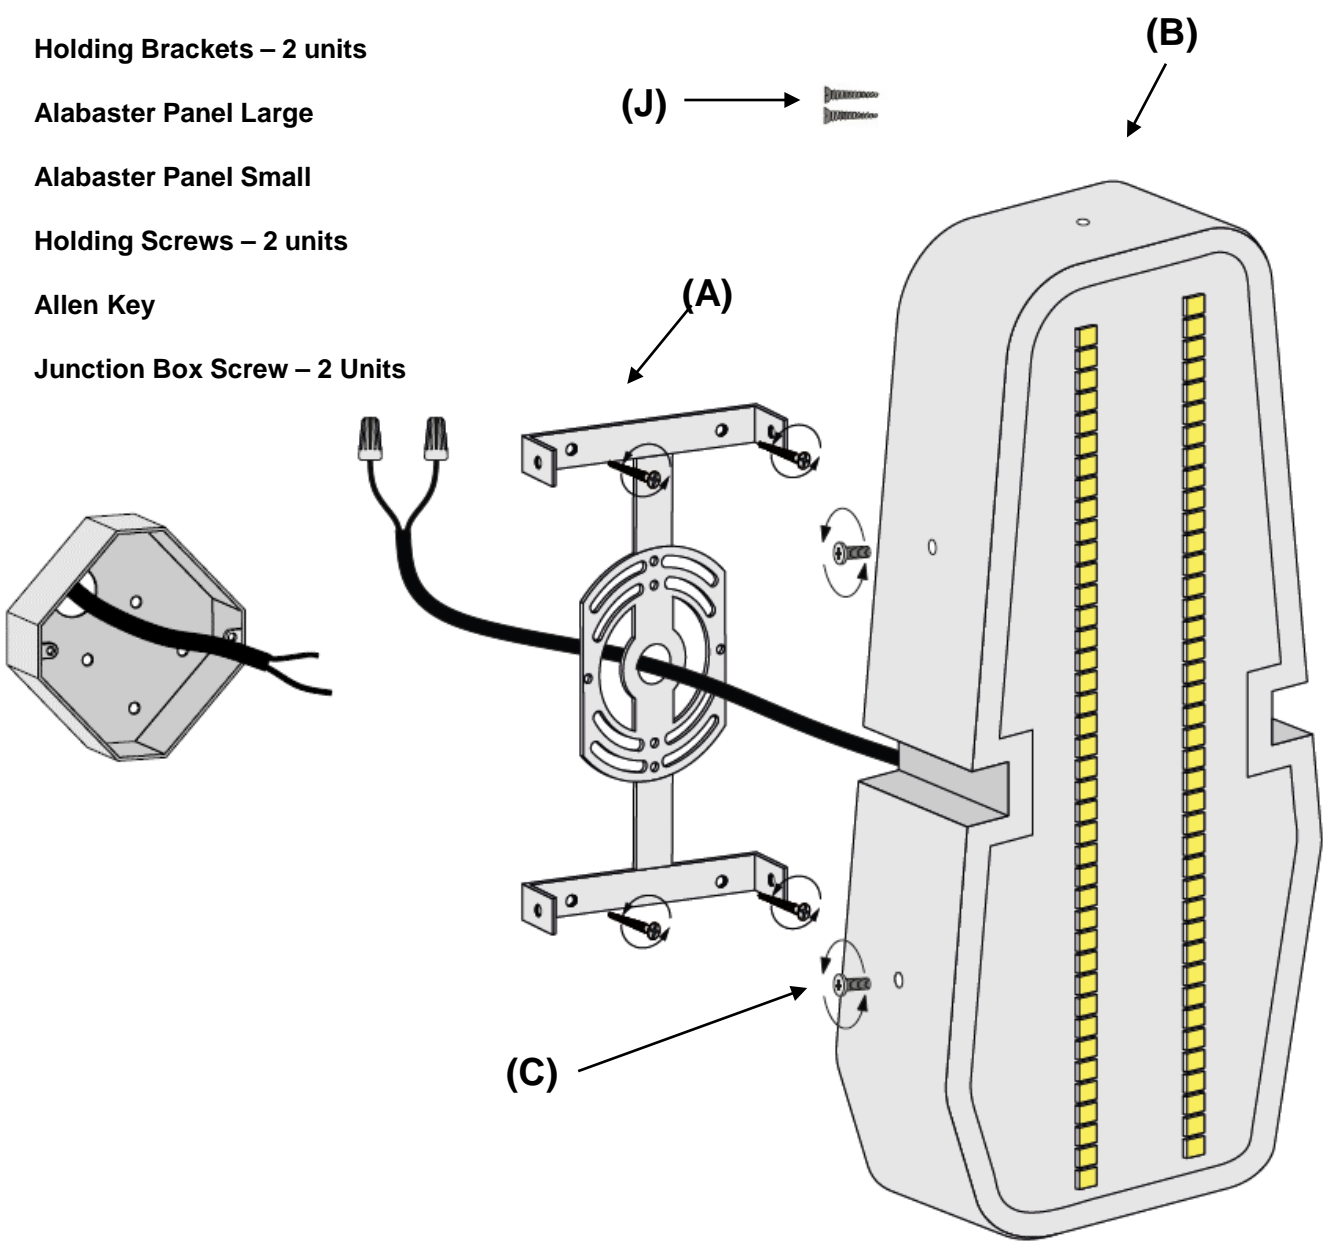

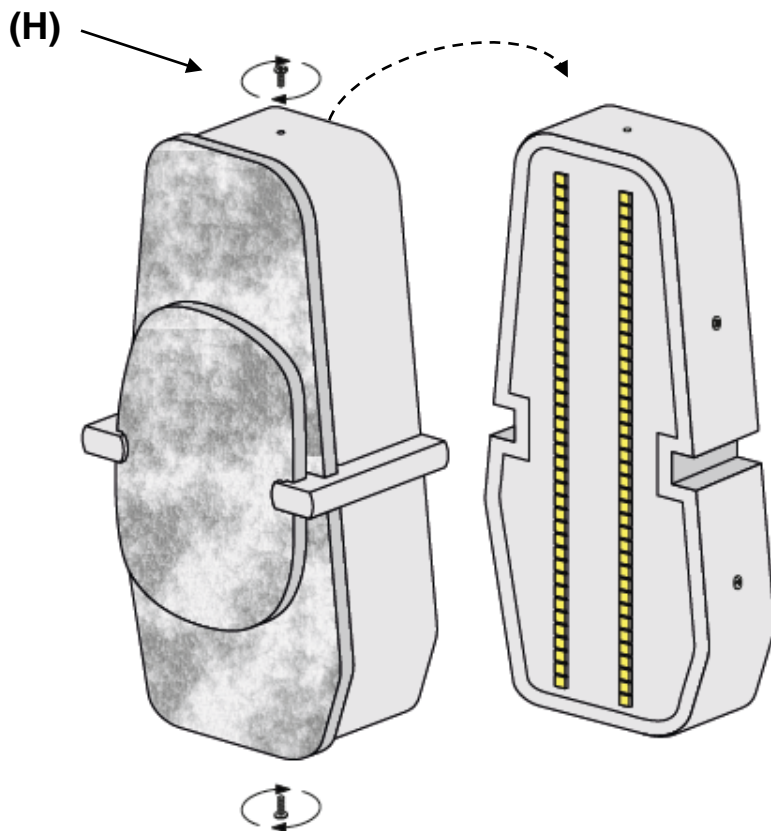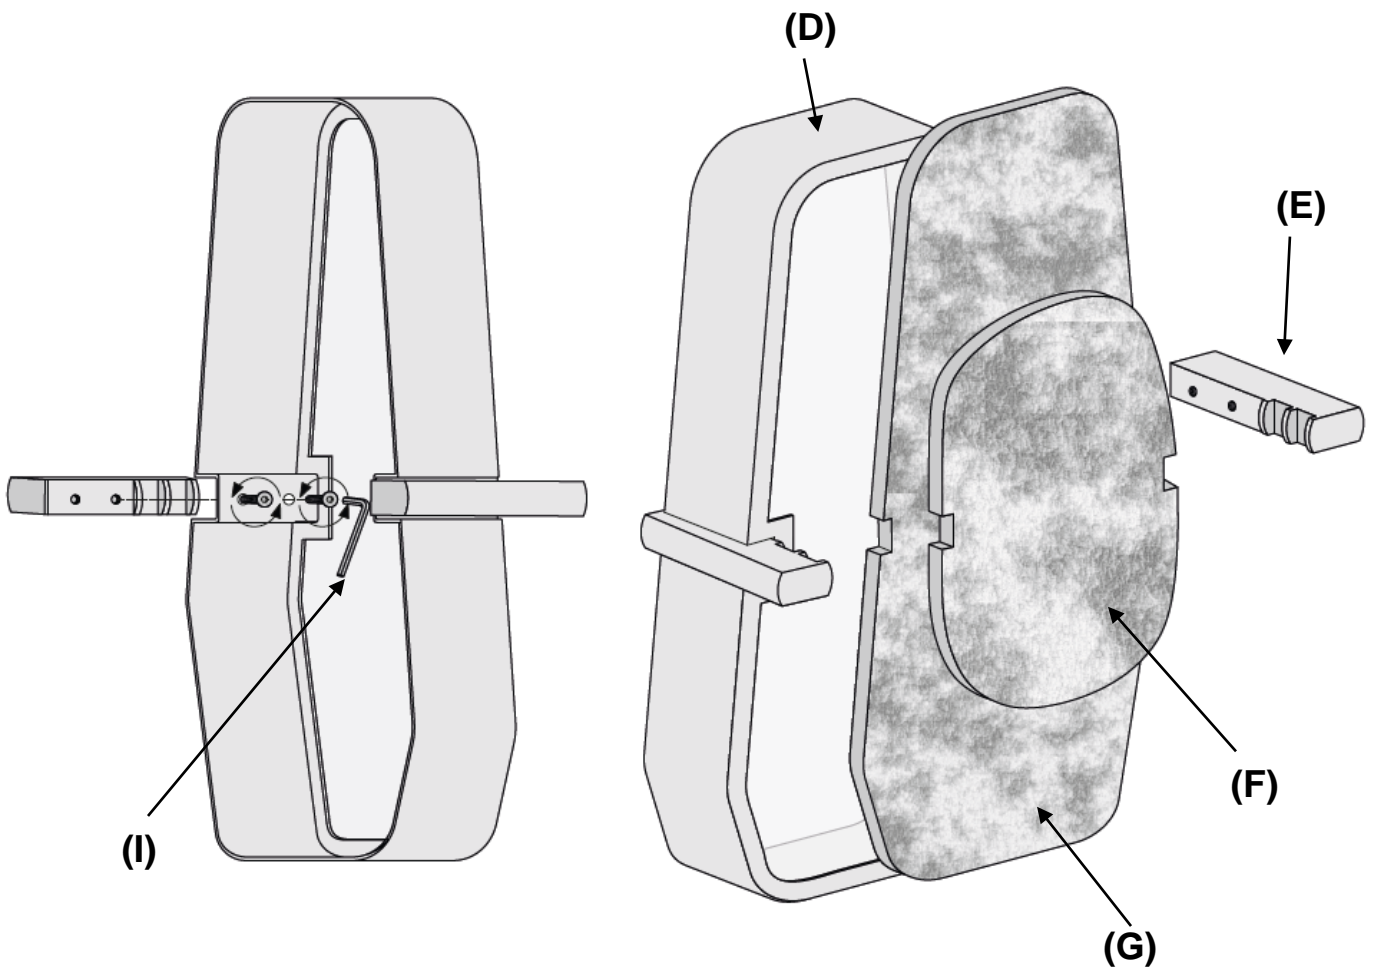

Installation Instructions:

- **SHUT OFF THE MAIN ELECTRICAL SUPPLY FROM THE MAIN FUSE BOX/CIRCUIT BREAKER.**
- Gently pull existing wires down from the wall junction box and allow them to hang.
- Unscrewing Holding screws (E) and remove Sconce (D) from Inner Box (B).
- Detach Mounting Plate (A) from the Inner Box (B) by unscrewing Holding Screws (C).
- Use pencil and mark four locations through the Mounting Plate (A) over the junction box. Set Flush Anchors in the wall. Also attach to junction box using screws (J).
- Attach the Mounting Plate (A) to the wall with Anchors / Bolts (not included) which are intended for your wall type. Also, attach to the junction box with screws provided.

Note – Using a standard water level, ensure that the Mounting Plate (A) is perfectly straight. This is important to ensure the sconce hangs straight.

• Establish electrical connections:

- Connect the NEUTRAL FIXTURE WIRE (Blue) to the NEUTRAL JUNCTION BOX WIRE. Fasten each together with a wire connector and wrap the connection with electrical tape. Be sure that no wire strands are exposed.
- Connect the HOT FIXTURE WIRE (Brown) to the HOT JUNCTION BOX WIRE. Fasten each together with a wire connector and wrap the connection with electrical tape. Be sure that no wire strands are exposed. **DO NOT REVERSE THE HOT AND NEUTRAL CONNECTIONS OR SAFETY WILL BE COMPROMISED.**
- Connect the GROUND WIRE of the fixture to the GROUND Junction Box WIRE (copper bare) with a wire connector and wrap the connection with electrical tape. Be sure that no wire strands are exposed. If there is no ground wire in the Junction Box, use a screwdriver to secure the end of the fixture ground wire to the GREEN screw located on the Cross bar.
- After all connections are made, install the Inner Box (B) and fix it by Holding Screws (C).
- Unscrew the Allen screws from inside of the Sconce (D) use Allen Key (I) and take out one Holding Bracket (E).
- Carefully Insert Alabaster Panel large (G) first and then Panel small (F) (as shown in the picture) to the another Holding Bracket and tighten back Holding Bracket (E) which was removed.
- Attach Sconce (D) with Alabaster panels to the Inner Box (B) and fix it by Holding Screws (H).
- Installation is complete.


Care Instructions:

- Do not use abrasive cleaning solution as it may cause damage to the fixture's finish.
- Wipe clean with a soft, dry cloth or static duster.

PALECEK®

601 PARR BOULEVARD | RICHMOND | CA 94801

LED Driver Replacement Instructions

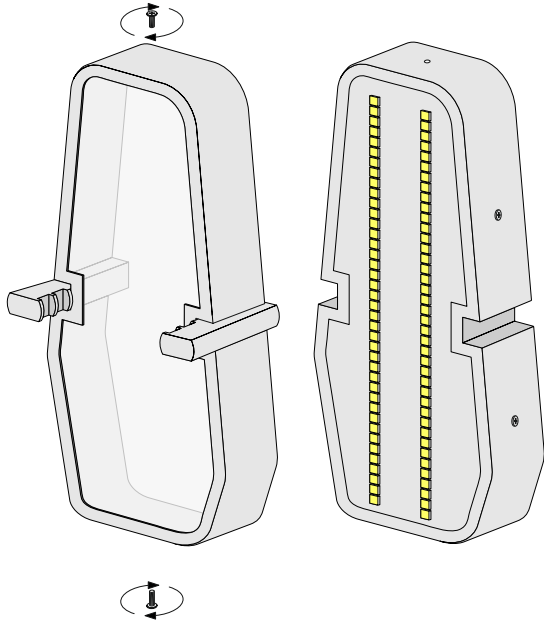


Instructions:


SHUT OFF THE MAIN ELECTRICAL SUPPLY FROM THE MAIN FUSE BOX/CIRCUIT BREAKER.

To replace the LED driver,

1 - Remove Scence from the Inner Box by unscrewing Holding Screws.

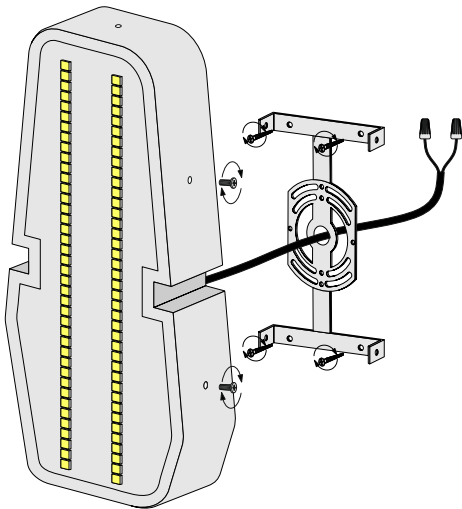

2 - Remove Inner Box by unscrewing Holding Screws.

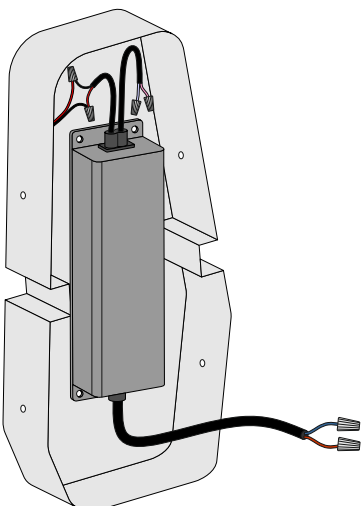

3 - Remove the electrical connections and unscrew the LED driver from the Inner Box. Replace new LED driver and attach to the Inner Box and establish electrical connections to the appropriate wires. Match specifications of the installed LED Driver. Connect the Fixture wires to the LED driver Output wires (Black) and (Red). Fasten each together with a wire connector and wrap the connection with electrical tape. Be sure that no wire strands are exposed.

LED Driver/LED Strip Replacement Instructions

PROFESSIONAL INSTALLATION REQUIRED

CAUTION: Before replacing LED Driver / LED Strip, make sure the power to the circuit is turned off at the main FUSE BOX / CIRCUIT BREAKER utility box.

Important Safety Instructions:

Installation by a licensed professional electrician required.

WARNING:

When the unit is no longer functioning, do not attempt to fix it by yourself. Only a qualified technician is allowed to disassemble and repair.

If the external flexible cable cord of this luminaire is damaged it shall be exclusively replaced by a qualified electrician in order to avoid hazard.

Installation Instructions:

SHUT OFF THE MAIN ELECTRICAL SUPPLY FROM THE MAIN FUSE BOX/CIRCUIT BREAKER.

To replace the LED driver, remove Canopy/Backplate of the Chandelier/Wall Sconce and see how the LED driver is fitted.


Remove the electrical connections and unscrew the LED driver from the Canopy/Backplate.

Replace new LED driver and attach to the Canopy/Backplate and establish electrical connections to the appropriate wires.

Match specifications of the installed LED Driver. Connect the Fixture wires to the LED driver Output wires (Black) and (Red).

Fasten each together with a wire connector and wrap the connection with electrical tape.


Be sure that no wire strands are exposed. (LED Driver diagram showing below).

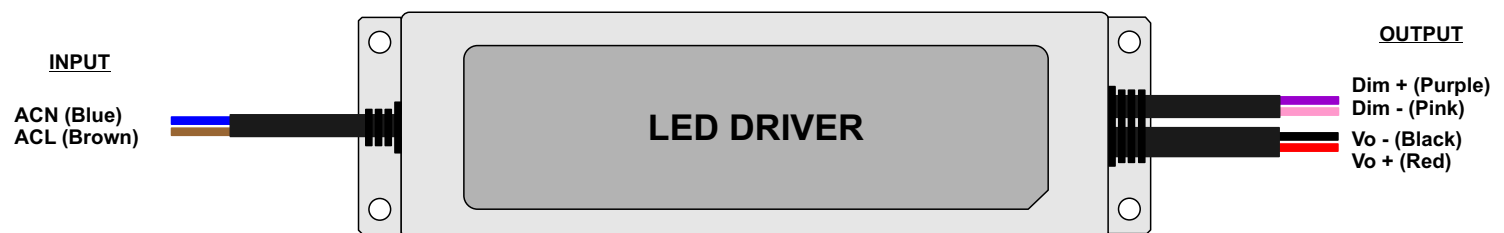

To replace the LED strip, Electrician will disassemble the fixture and remove the LED strip. Replace new LED strip as the original and establish electrical connections matching the specification of original strip.

LED Strip Spec- COB-24V-320S-W-2700k

■ DIMMING OPERATION


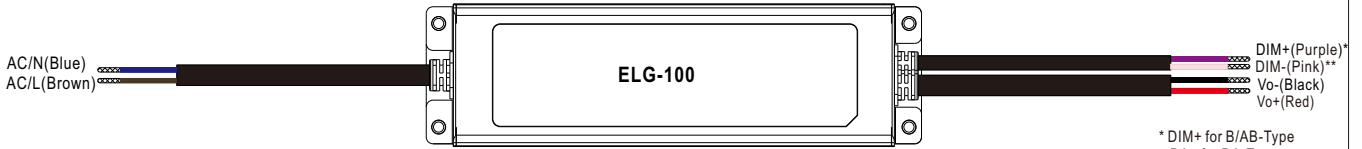


※ 3 in 1 dimming function (for B/AB-Type)



- Output constant current level can be adjusted by applying one of the three methodologies between DIM+ and DIM-: 0 ~ 10VDC, or 10V PWM signal or resistance.
- Direct connecting to LEDs is suggested. It is not suitable to be used with additional drivers.
- Dimming source current from power supply: 100 μ A (typ.)

* DIM+ for B/AB-Type
 DA+ for DA-Type
 PROG+ for D2-Type
 ** DIM- for B/AB-Type
 DA- for DA-Type
 PROG- for D2-Type



◎ Applying additive 0 ~ 10VDC

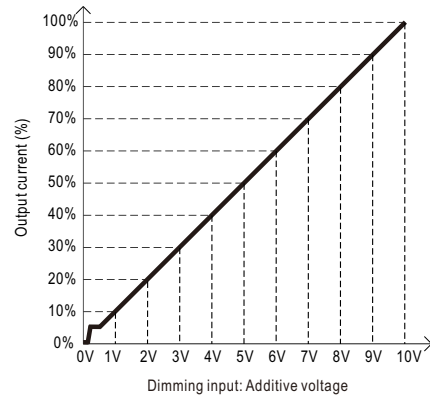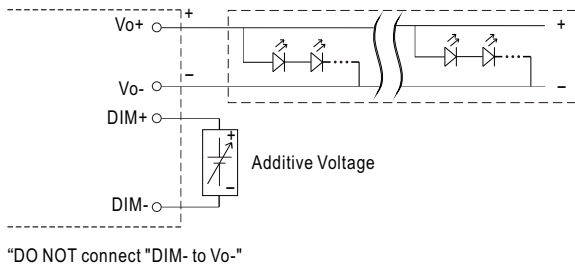

◎ Applying additive 10V PWM signal (frequency range 100Hz ~ 3KHz):

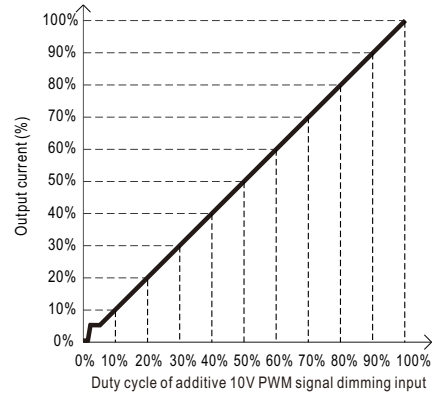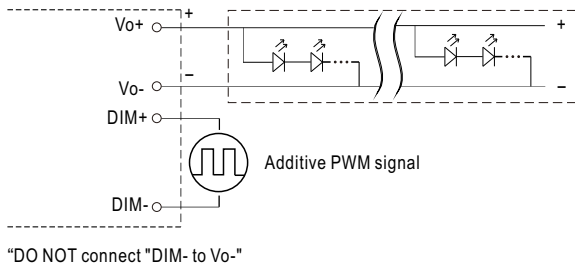

◎ Applying additive resistance:

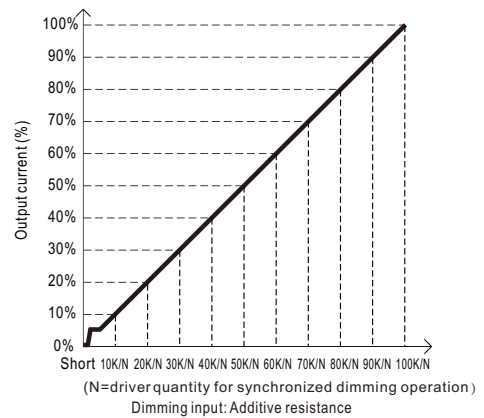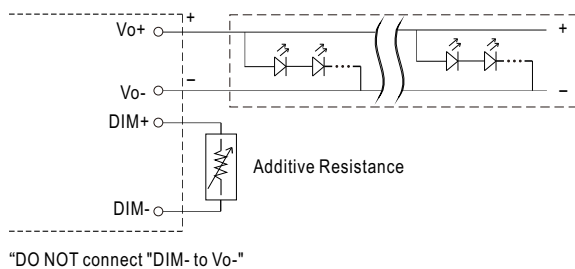

Note : 1. Min. dimming level is about 8% and the output current is not defined when 0% < I_{out} < 8%.
 2. The output current could drop down to 0% when dimming input is about 0k Ω or 0Vdc, or 10V PWM signal with 0% duty cycle.